

FIREFIGHTING EQUIPMENT TO COMPLY WITH BS EN 3, BS 7863 : 1996, BS 5306 - 3 : 2000 AND BS 5306 - 8 : 2000



SIGNS AND NOTICES TO COMPLY WITH THE HEALTH AND SAFETY (SAFETY SIGNS AND SIGNALS) REGS 1996 AND/OR BS 5499 : PART 1 : 1990

A CERTIFICATE OF COMPLIANCE TO THE ABOVE STANDARDS SHOULD BE LODGED WITH THE LOCAL FIRE OFFICER

FOR CONTINUATION OF LICENSED AREA. SEE SITE PLAN (INSET)

SYMBOL AND SHADING KEY

- PERIMETER OF LICENSED PREMISES
- DRY POWDER EXTINGUISHER - 9KG ▲
- ALCOHOL DISPLAY AREA TOTAL 0.14M²
- NO PUBLIC ACCESS AREAS

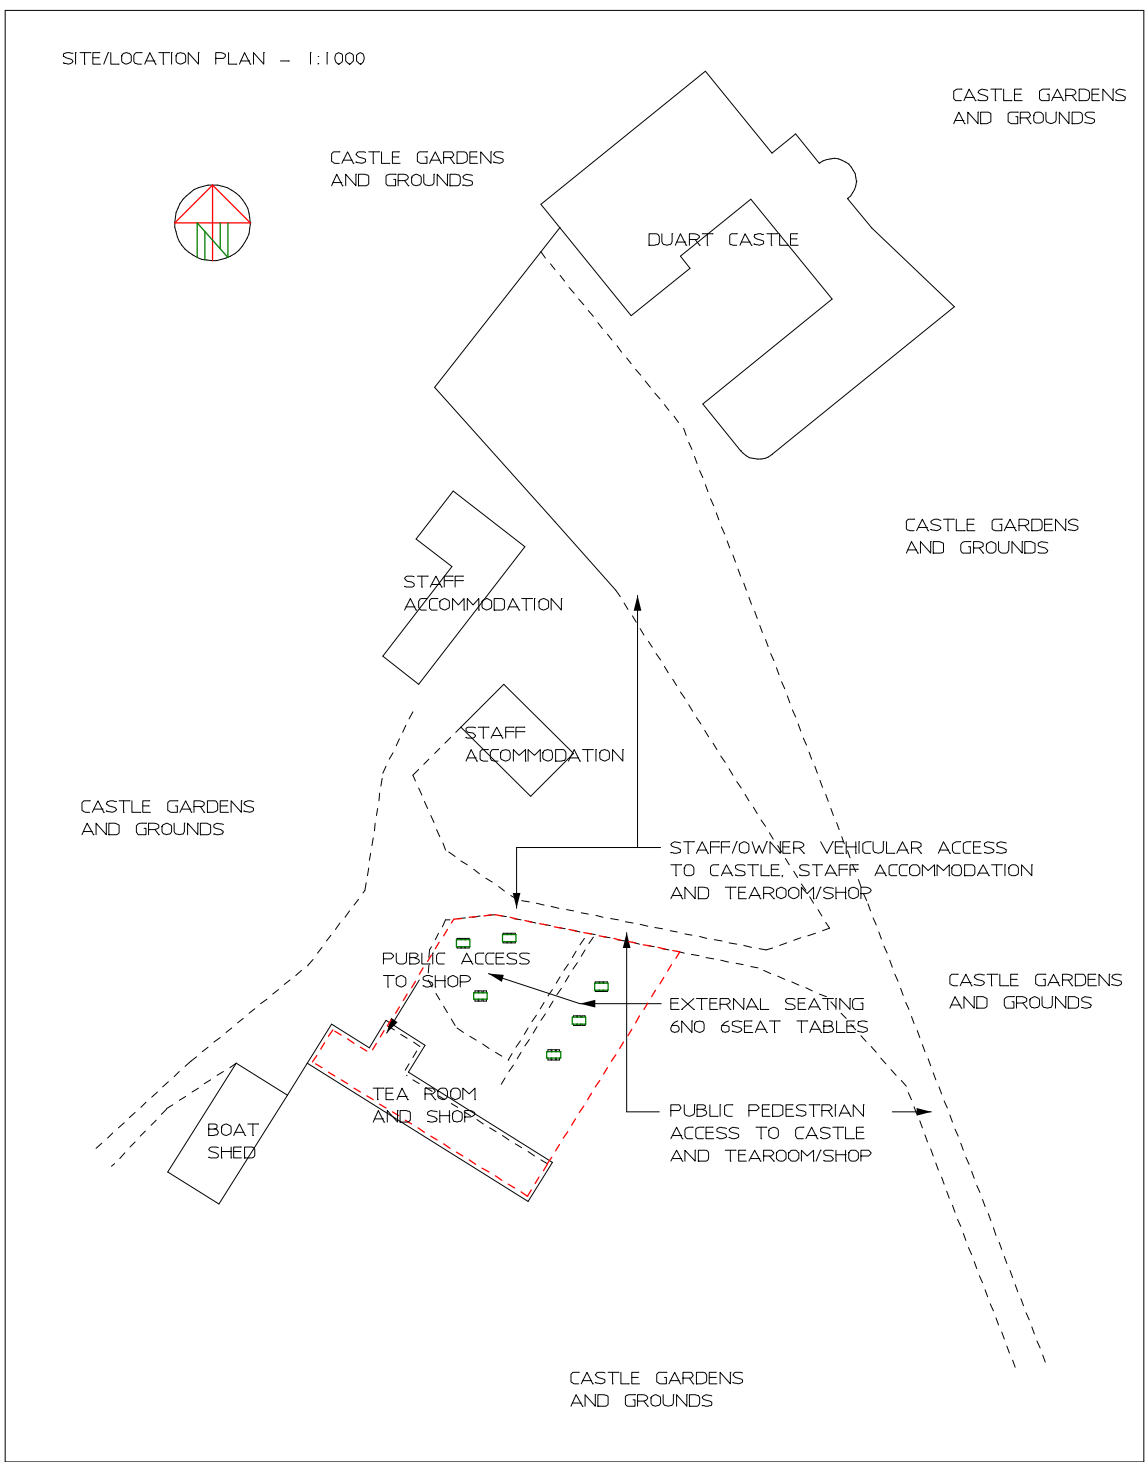

JOHN J RODGERS (AIOB)
 CEOL NA MARA, CRAIGNURE, ISLE OF MULL
 TEL: 01680812590 EMAIL: john.j.rodgers@btinternet.com

DUART CASTLE SHOP AND TEA ROOM
 LICENSING PLANS

LM/08/01A 1:100 26/05/08
 Rev A - updated plans - 17/1/18