


Plan 1

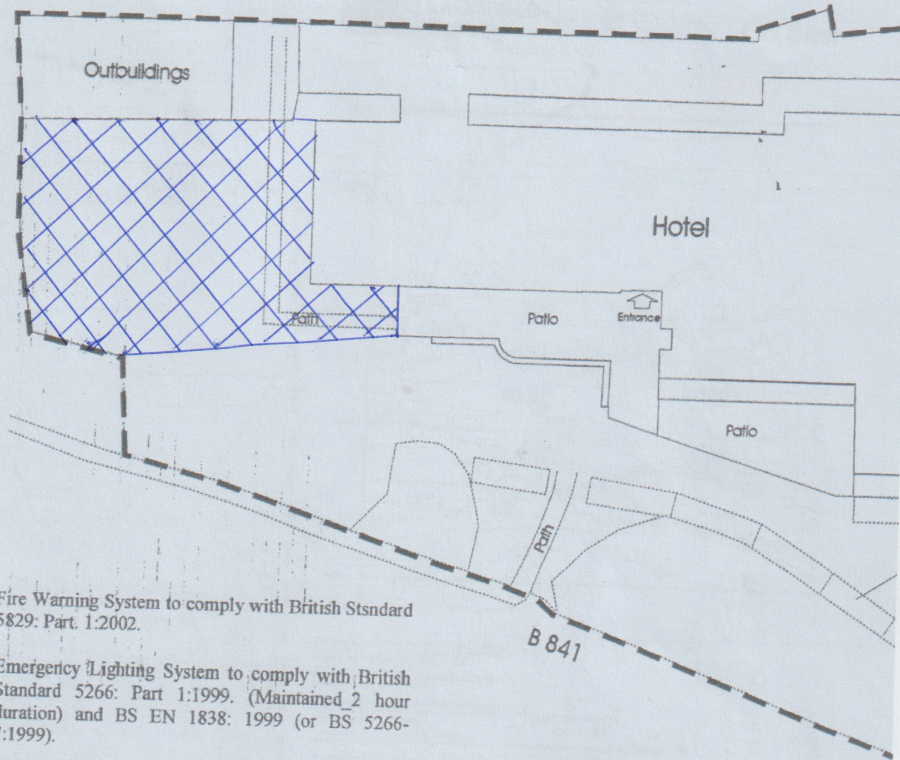

Fire Warning System to comply with British Standard 5829: Part 1:2002.

Emergency Lighting System to comply with British Standard 5266: Part 1:1999. (Maintained 2 hour duration) and BS EN 1838: 1999 (or BS 5266-7:1999).

Firefighting Equipment to comply with British Standard EN3, British Standard 7863: 1996, British Standard

5306-3:2000 and British Standard 5306-8: 2000. Signs and Notices to comply with the Health and Safety (Safety Signs and Signals) Regulation 1996 and/or British Standard 5499: Part 1:1990.

The applicant must ensure that the upholstered furniture satisfies the Cigarette and Match Ignitability Test specified in British Standard 5852:1990 (1998). (Note for existing furnishings only).

A Certificate of Compliance to the aforementioned British Standards should be issued by a competent person and forwarded to the Fire Authority prior to, or on the date of final inspection of the premises.

	Fire Alarm
	Carbon Dioxide Extinguisher
	Water Extinguisher
SC	Self Closing Door
	Emergency Lighting Point
EXIT	Illuminated Exit Sign
HD	Heat Detector
SD	Smoke Detector
FB	Fire Blanket
	Fire Alarm Call Point (Breakglass)
N	Fire Notification Notice

Extent of pr

Extent of Cu
Total Custor
Public Occu
(based on oc