
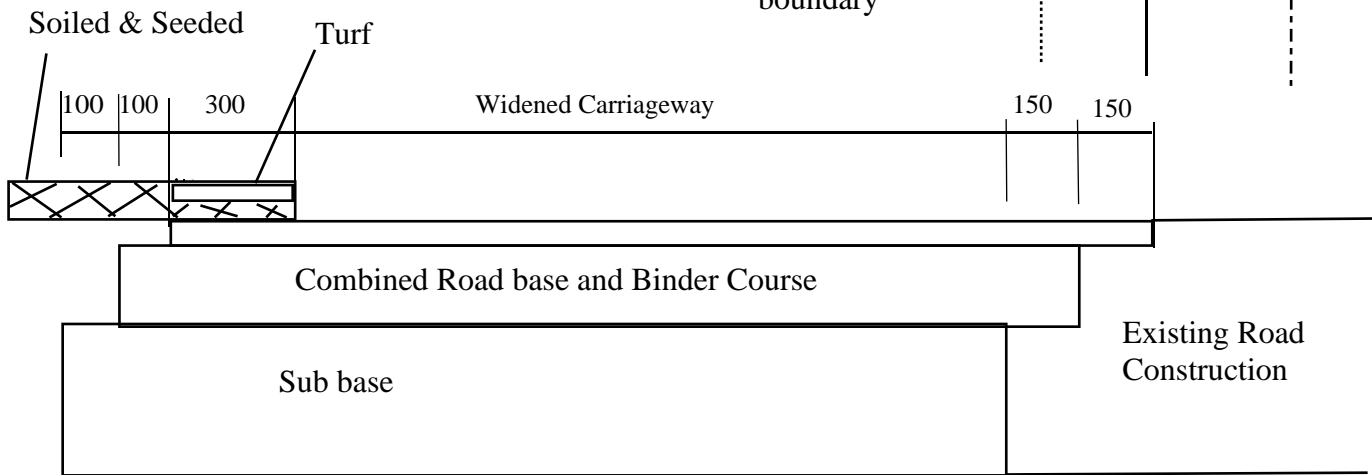
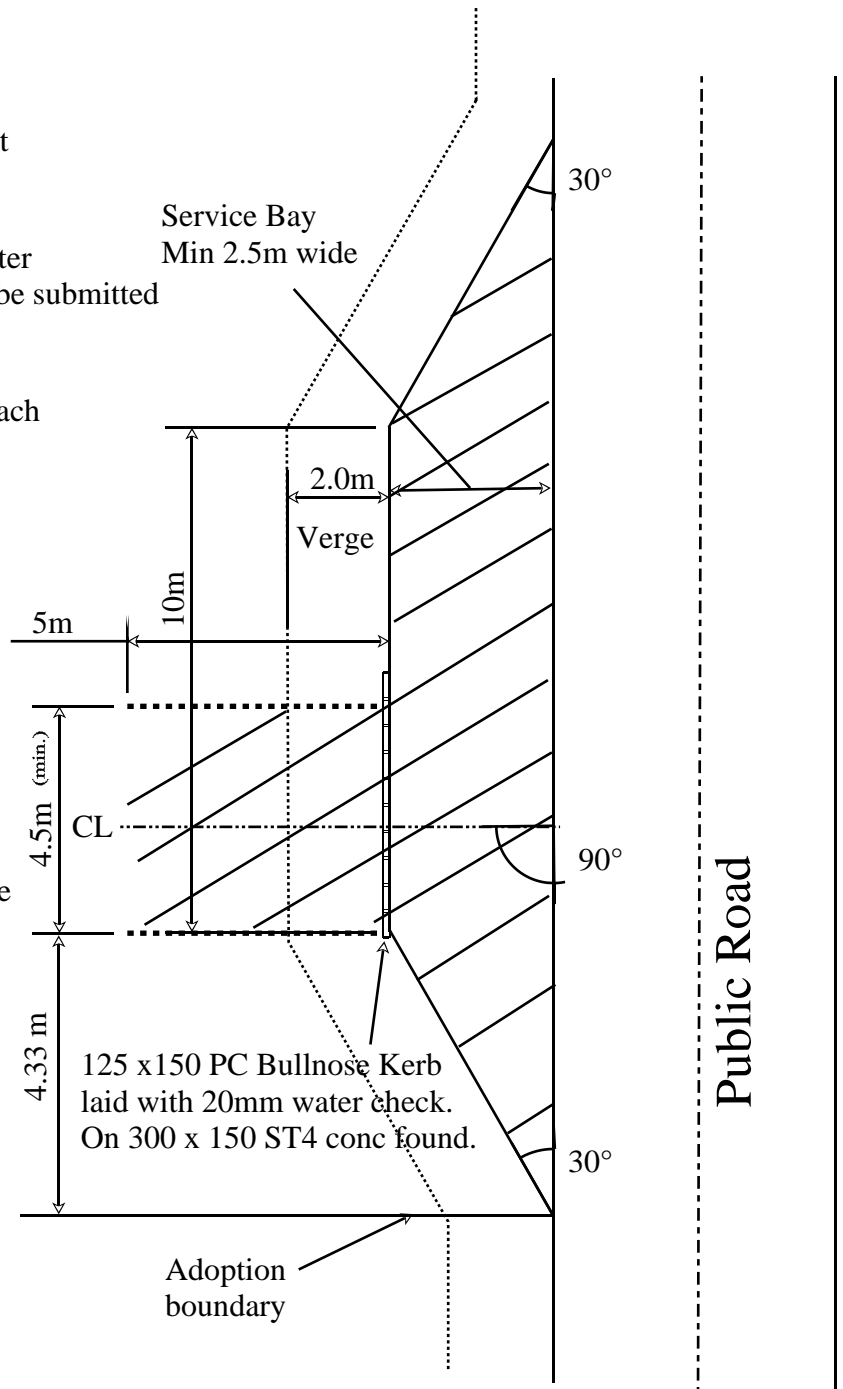


Notes.

1. Service Bay minimum width 2.5m, and first 2 m of access to be surface in accordance the specification. Remaining 3m of access must surface in a bound material.
2. Gradient over first 5 m to be less than 5% and access shaped or drained to prevent surface water discharge onto the public road arrangement to be submitted for approval by Roads Authority.
3. Walls, fences or hedges must be set no closer to the public road than 2 m and must not encroach into the visibility splay.
4. Any roadside ditch must be culverted to the satisfaction of the Roads Authority.
5. Surface water drainage to be carried to ditch or other drainage course.
6. Carriageway widening shall be formed in accordance with this standard detail and on satisfactory completion will form part of the public road.

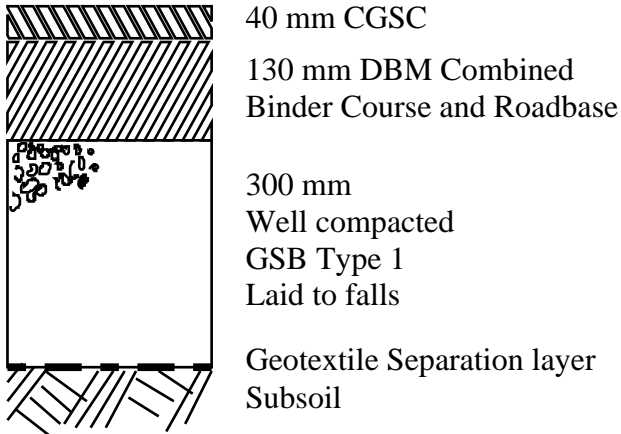

Cross Section

Service Bay Detail

**Argyll & Bute Council
 Operational Services**

Scale 1:150, NTS Date June 2008

Drawing No SD 08/006

REV. a